




STEP 1:
REMOVE COATING TO BARE METAL
SURFACE SECTIONS 200x100mm

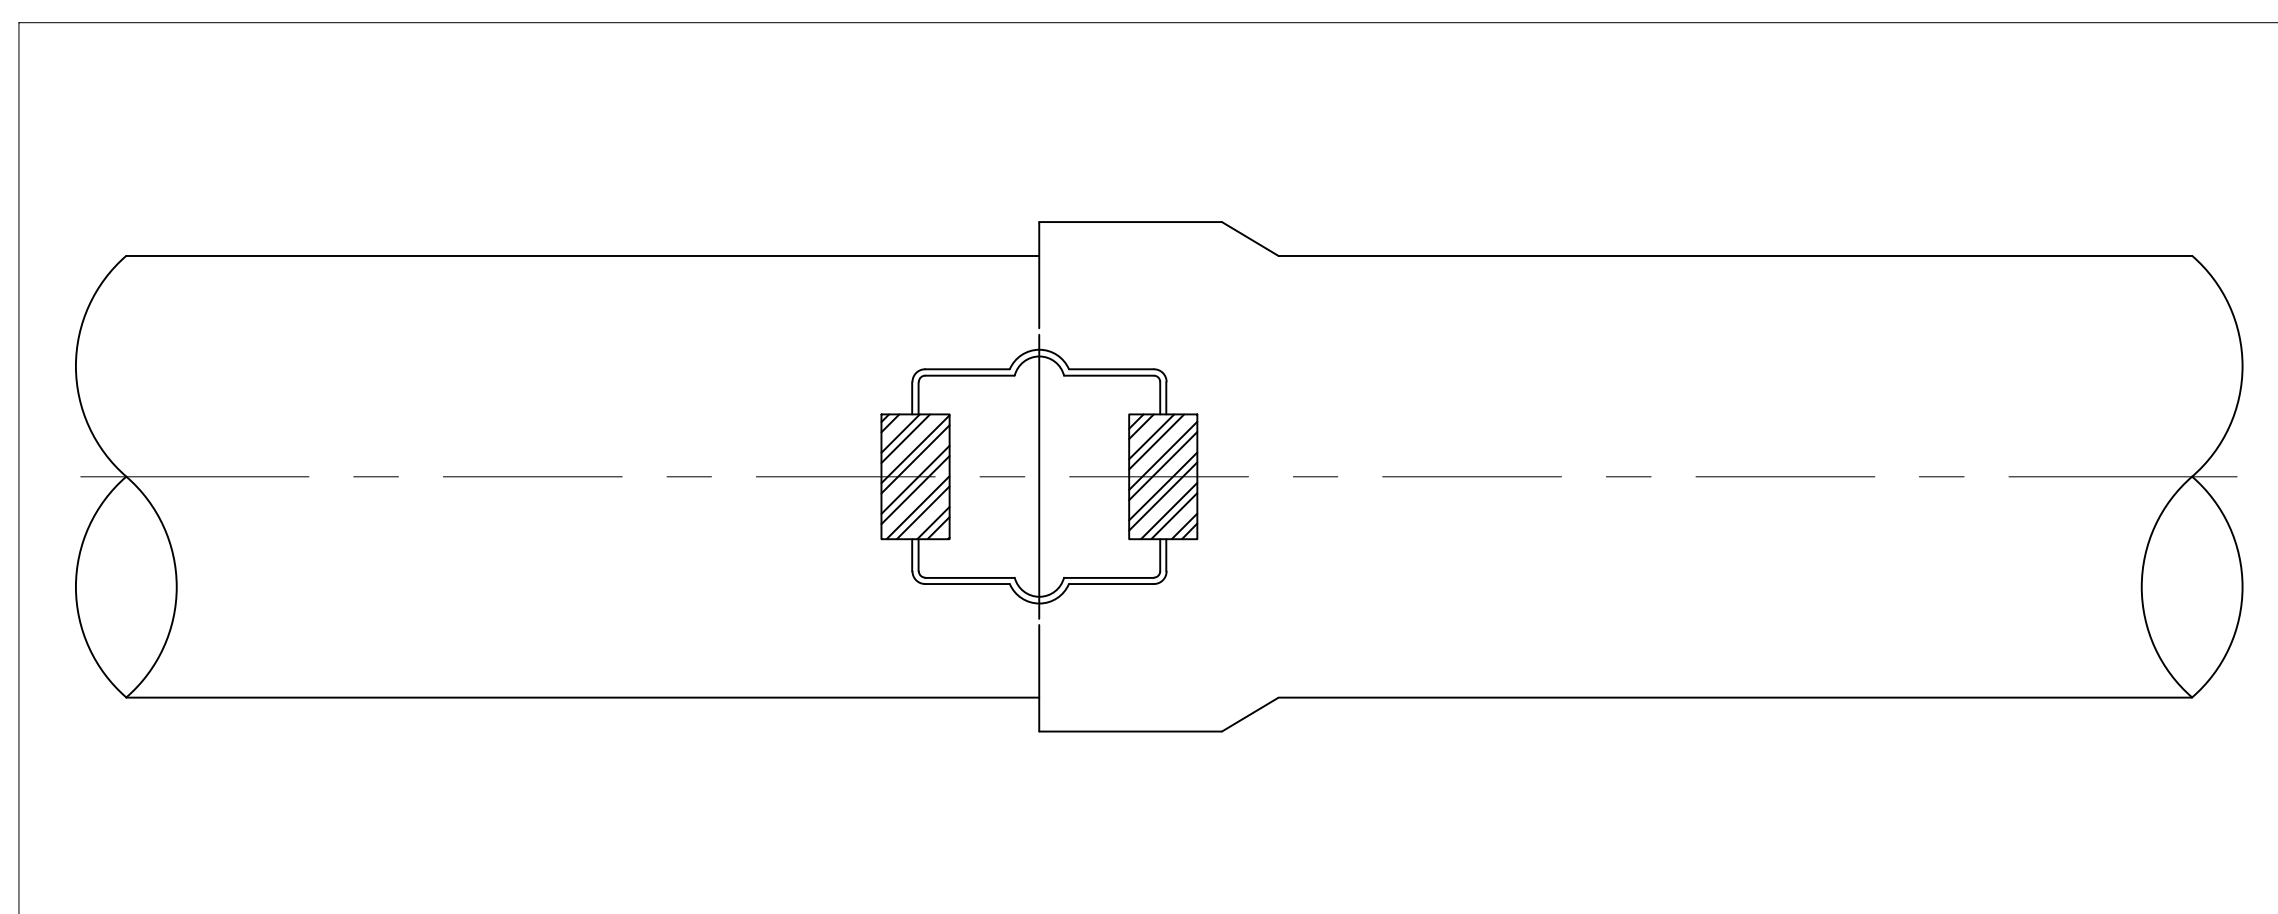

STEP 3:
COATING REPAIR USING DENSO PRIMER D, BUTYL PROFILING
MASTIC,DENSOTHERM H.D AND DENSO
CPT 1000 BLACK COLD APPLIED TAPE COVERING
THE DENSOTHERM H.D.

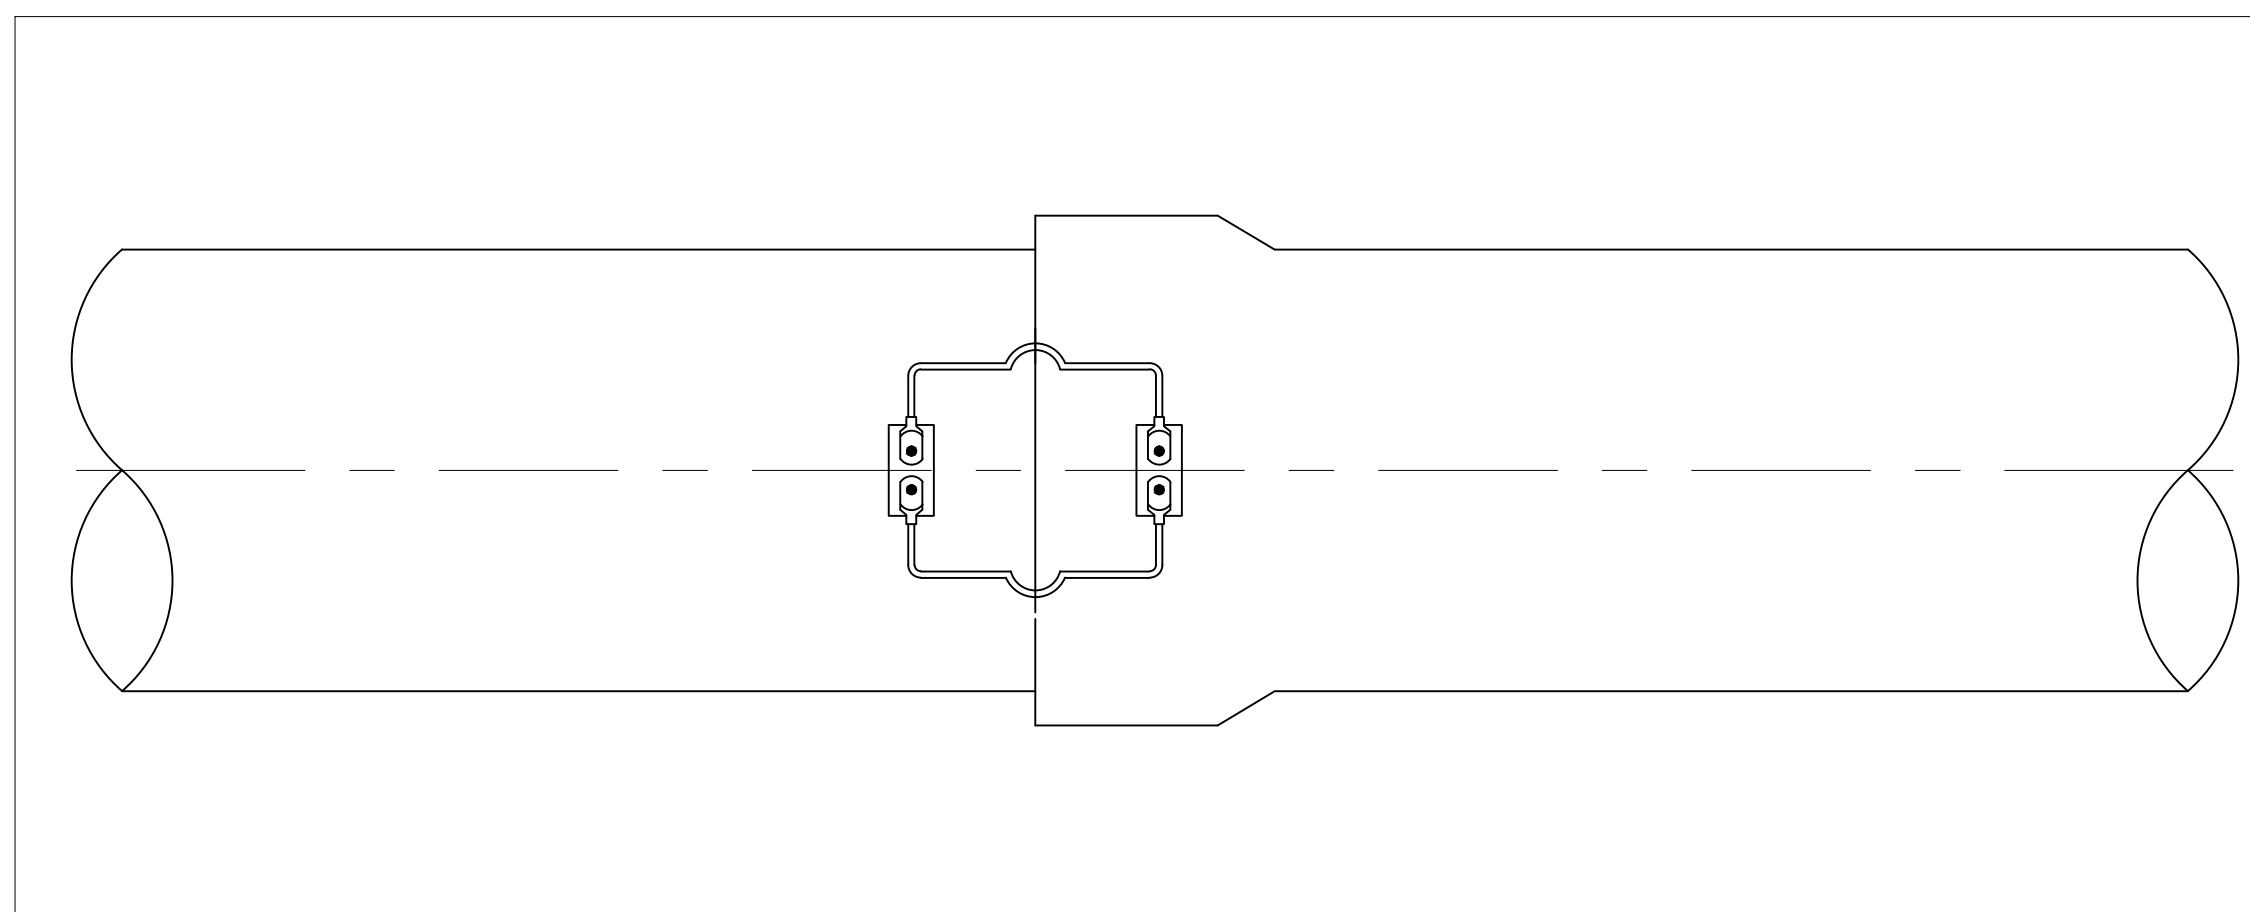

STEP 2:
M8x20mm STUD WELD, ATTACH 2x10mm² PVC/PVC BLACK
SINGLE CORE COPPER CABLES WITH M8 LUGS & LOCKNUT

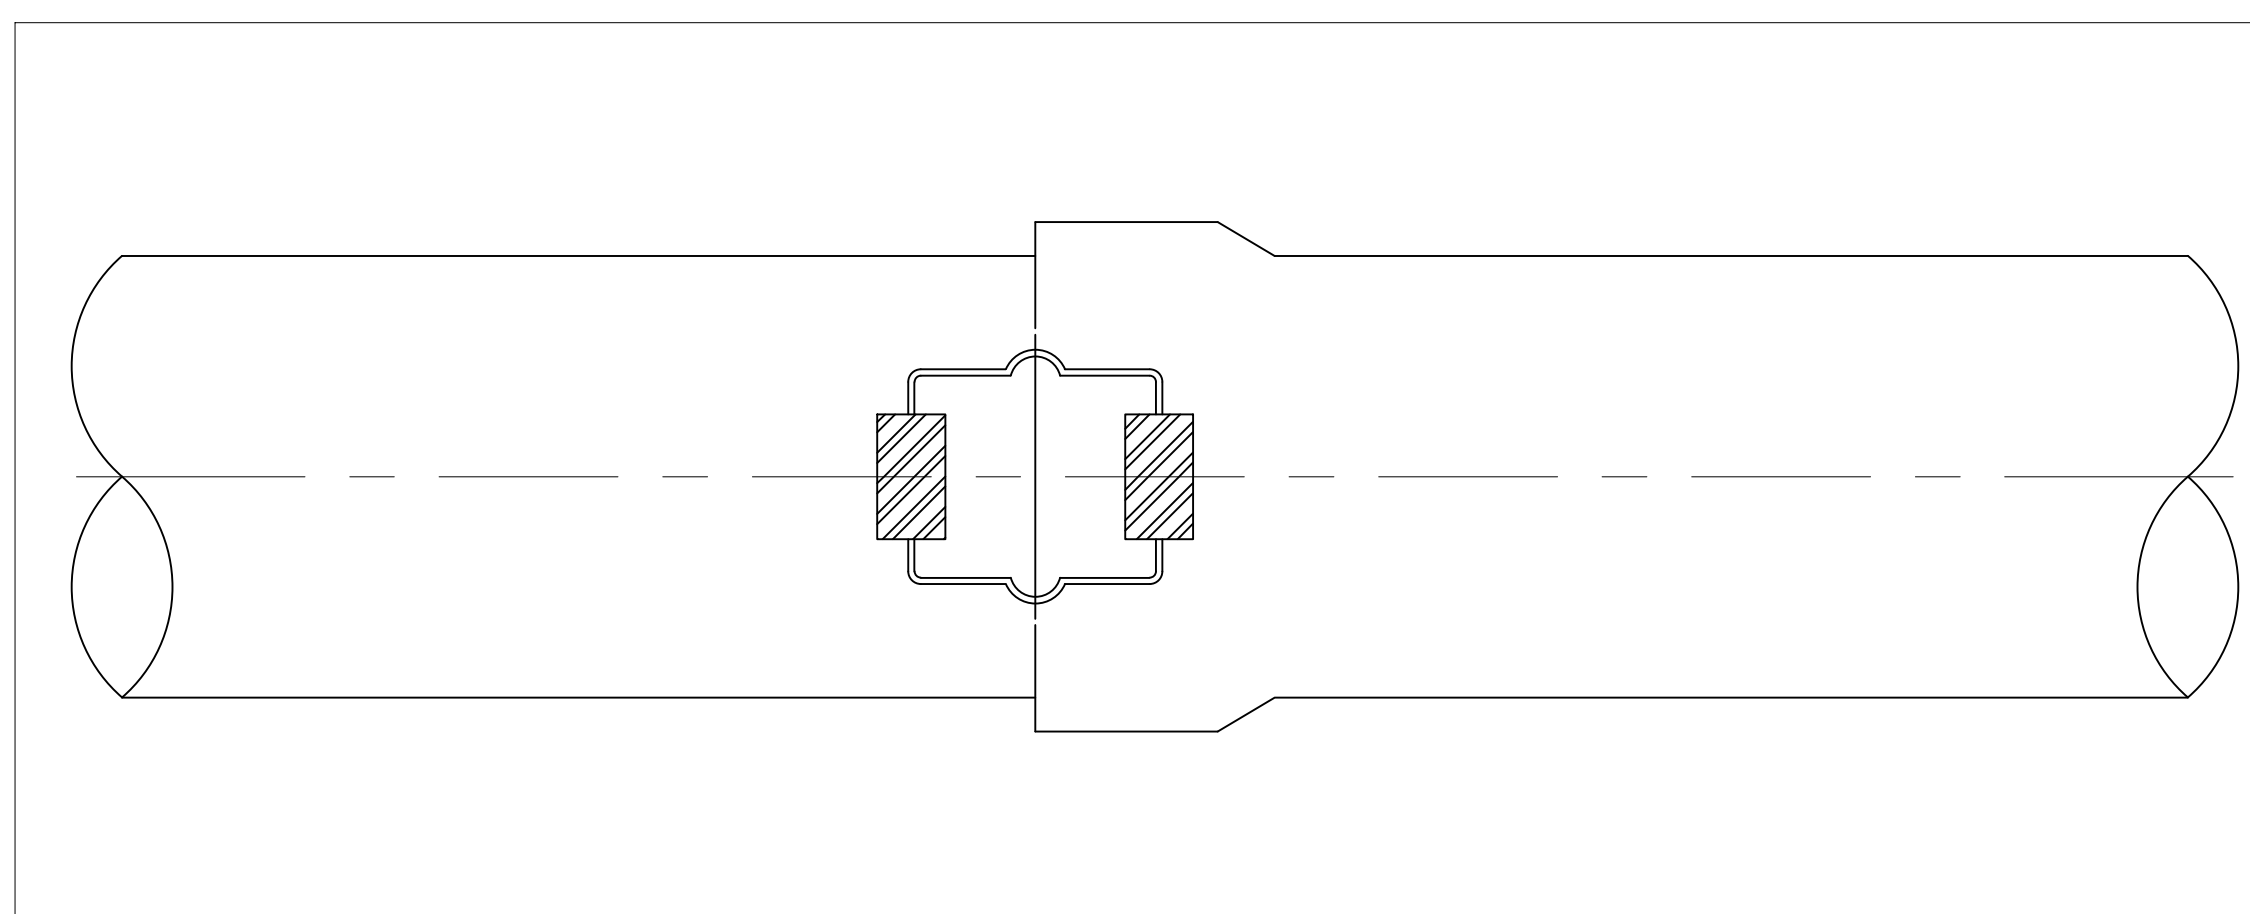

STEP 4: PHOTOGRAPH, SIGN-OFF, AND RECORD KEEPING.

No	Date	Details	Chd	
Business				



16



Approved By _____

Drawn By
R. ALLEY

Designed By	M. SHERRA
-------------	-----------

Reviewed By	M. SHERRAT
-------------	------------

Project

LINBRO PARK TOWER
 (AND ASSOCIATED WORKS)
 CP DESIGN

Description

Description	CATHODIC PROTECTION PIPE JOINT CONTINUITY BONDING
-------------	---

Scale	AS SHOWN	Date	2023/02/1
-------	----------	------	-----------

Drawing No. PES-PEP0221-CP-008 / R C