


TYPICAL TRENCH SECTION ACROSS PAVED WALKWAYS AND OPEN GROUND

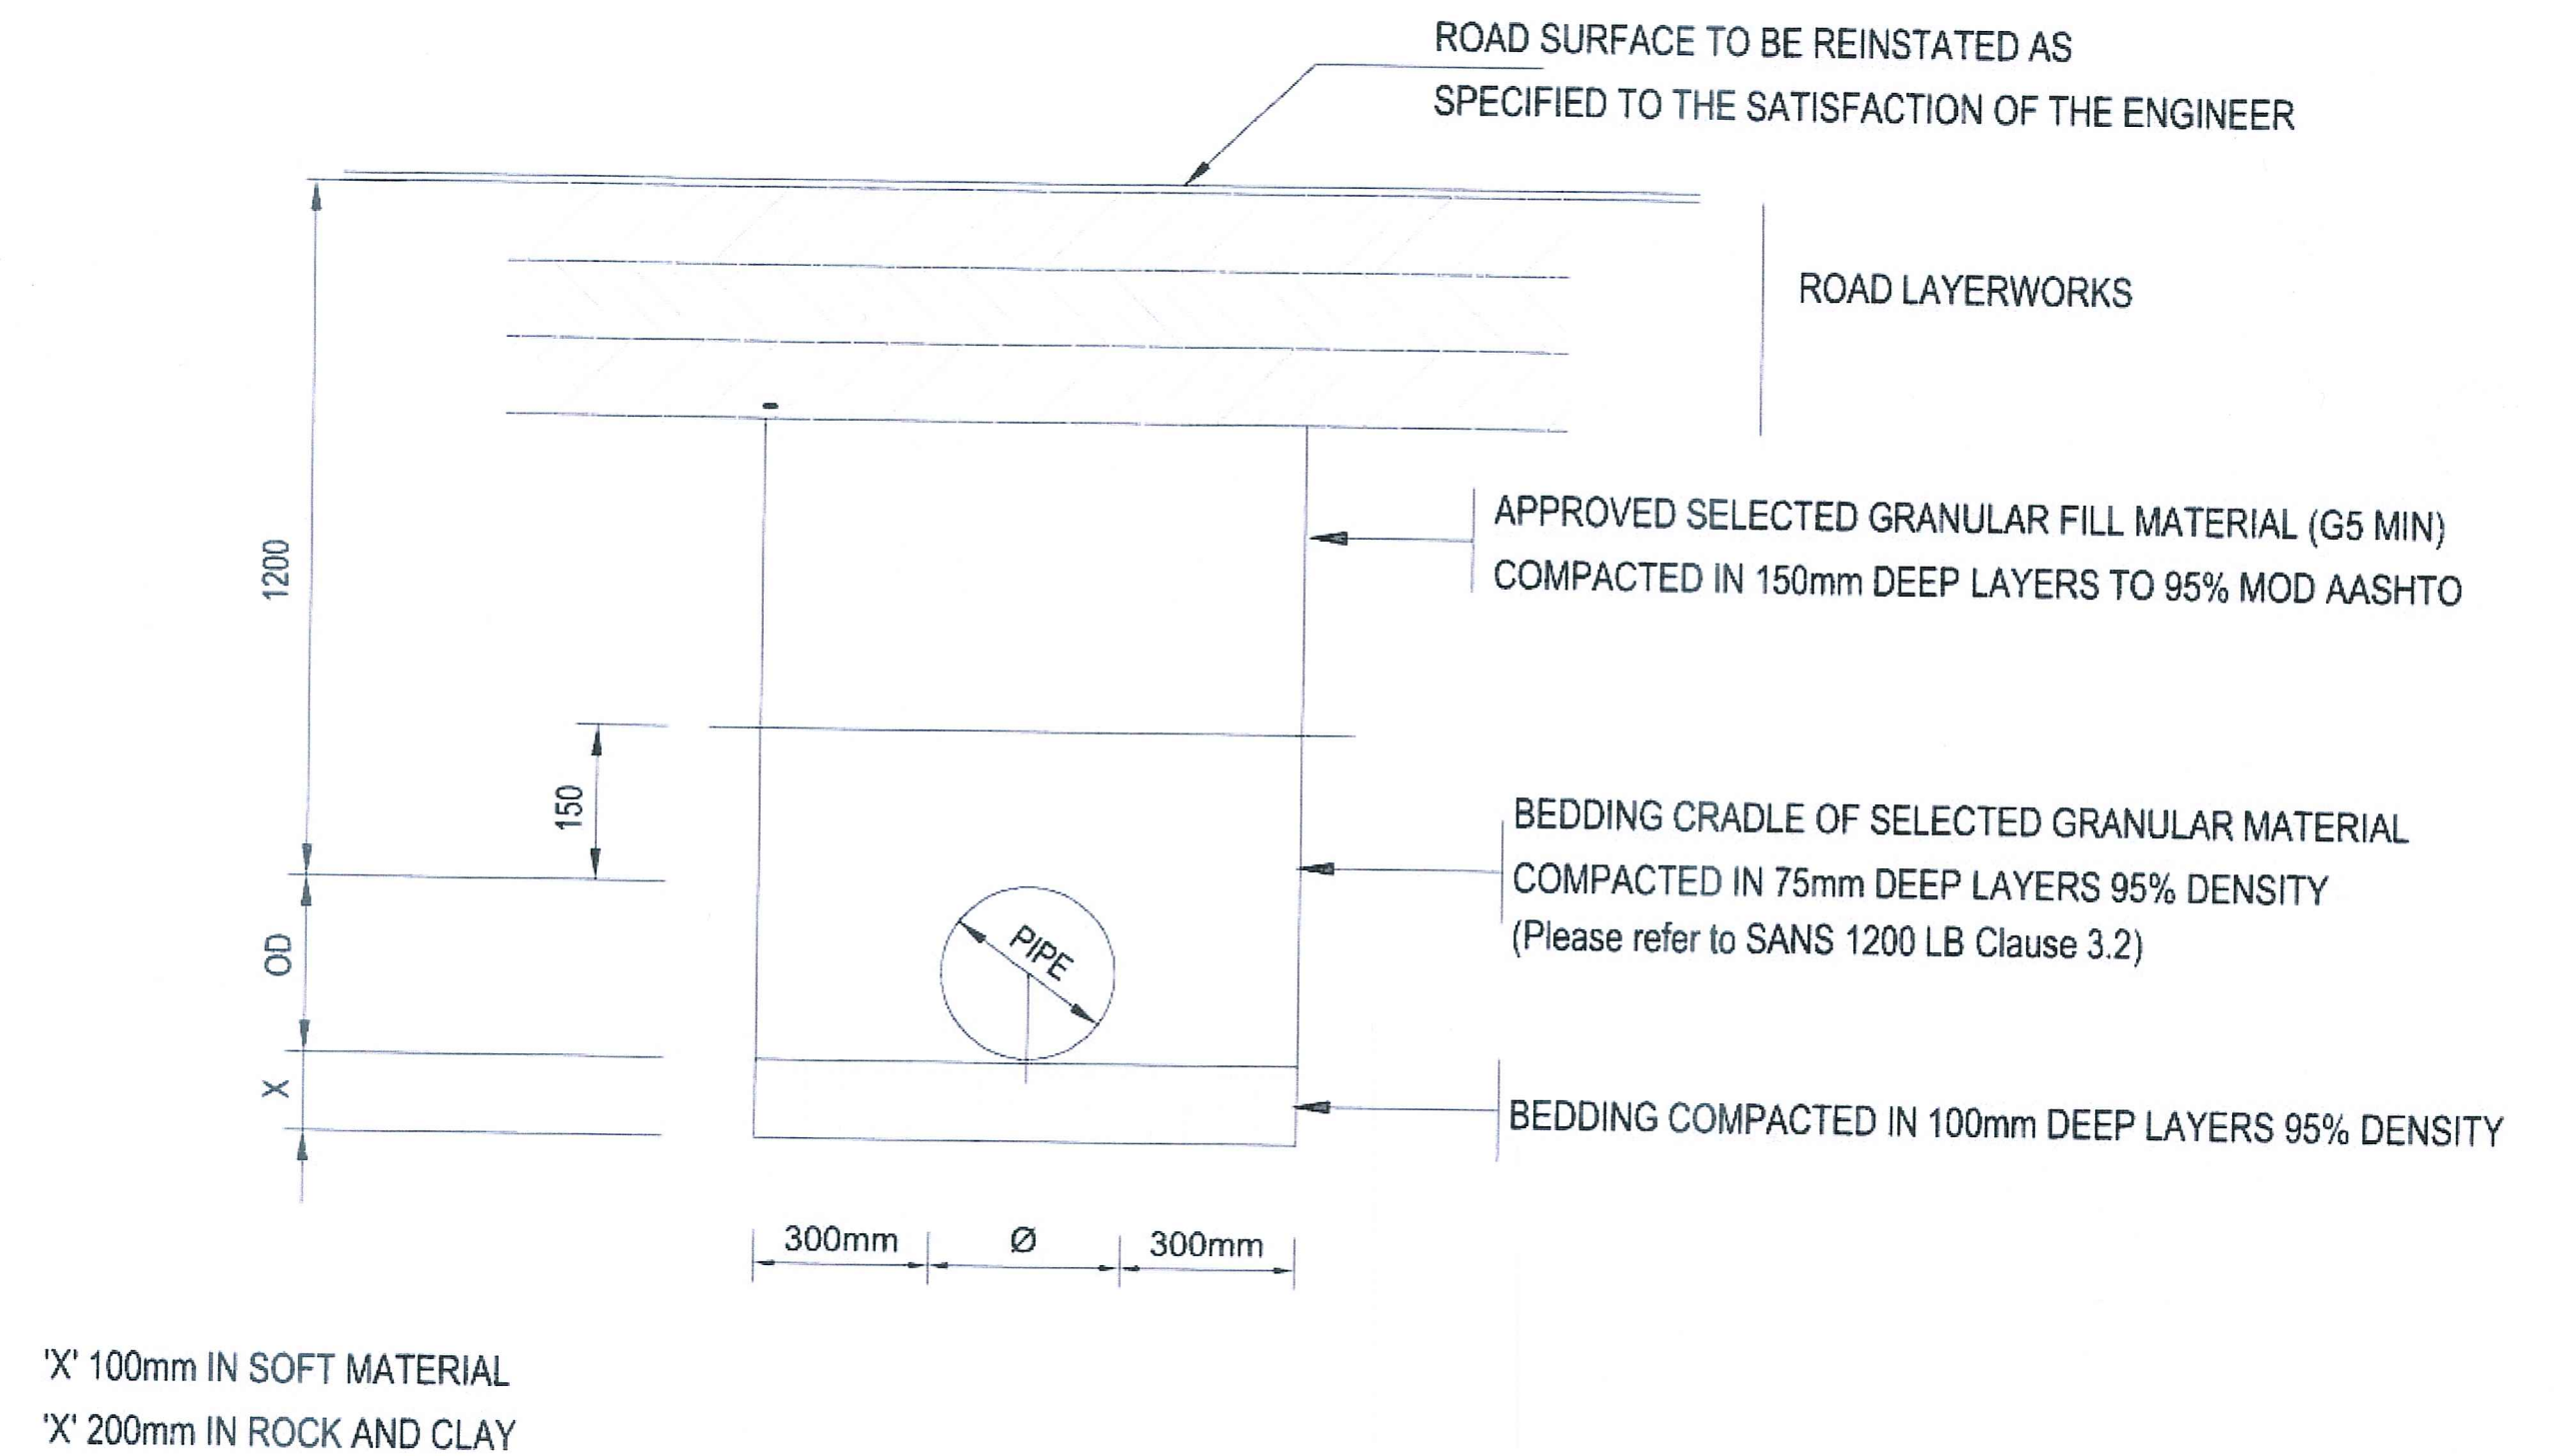

TYPICAL TRENCH SECTION BENEATH ROAD

NOTES:

1. PIPE SIDE ALLOWANCE OF 300mm TYPICAL FOR UP TO 700mm Dia. FOR PIPES GREATER THAN 700mm REFER TO SANS 1200DB CLAUASES 5.2 "MINIMUM BASE WIDTHS."
2. COMPACTION OF MAIN FILL TO MINIMUM MOD AASHTO OR THAT OF SURROUNDING IN SITU UNDISTURBED GROUND AND AS DIRECTED BY THE ENGINEER.
3. DIMENSIONS IN MILLIMETERS (mm)
4. REFER ALSO TO JRA AND OTHER SERVICE PROVIDERS SPECIFICATIONS FOR BEDDING DETAILS IN ROAD RESERVES OR WHERE THE PIPE INTERSECT WITH OTHER SERVICES.

CONSULTING ENGINEERS
CAPEX DESIGN SECTION
SWISS HOUSE
7TH FLOOR

DESIGNED	B.M. KHUMALO	MAY 2017
DRAWN	B.M. KHUMALO	MAY 2017
CHECKED	J. GUMBO	DATE: 19/7/17
SIGNATURE	<i>[Signature]</i>	
ECSA REG. No.	201370044	
APPROVED BY:	T. MPANDAGUTA	DATE:
SIGNATURE	<i>[Signature]</i>	
ECSA REG. No.	20170150	



17 HARRISON STREET
MARSHALLTOWN
2107
TEL: (011) 688-1400
FAX: (011) 688-1529

Joburg

STANDARD DETAIL
WATER BEDDING DETAILS

AMENDMENTS				
SCALE	REV.	DESCRIPTION	APPROVED	DATE

DRAWING No. JW100-DET02-W01

PROJECT No.	REV.
A3	2
SHEET	OF
ORIGINAL PAGE SIZE	FILE No.