
SECTION     A    

SECTION C


3. ALL AGGREGATE TO BE 19mm UNLESS OTHERWISE SPECIFIED
4. CONCRETE DESIGN MIXES TO BE SUBMITTED TO ENGINEER FOR COMMENTS PRIOR TO CONSTRUCTION.
5. CURB TESTS TO BE CARRIED OUT ON SITE AND LOGGED WITH POSITION AND DATE. CURBS TO BE TESTED FOR EACH TYPE OF CURB AND AT LEAST ONE SET DAILY AND FOR EACH TYPE OF CURB EVERY 50m<sup>3</sup>.
6. REINFORCEMENT TO BE IN ACCORDANCE WITH SANS 920 AND SHALL BE BENT IN ACCORDANCE WITH SANS 82
7. ALL CAST IN ITEMS SHALL BE FREE OF OIL, GREASE, DIRT AND ANY OTHER MATERIAL, WHICH MAY IMPAIR THE BOND WITH THE CONCRETE. CONTRACTOR TO PROVIDE AN ISPECT/ASPECT DRAWINGS FOR DETAILS/POSITIONS OF OPENINGS, SLEEVES, CONDUITING, ETC. FOR STRUCTURE. ADVISORY ENGINEER TO BE CONSULTED FOR DETAILS.
8. FOUNDATIONS HAVE BEEN DESIGNED FOR AN ALLOWABLE GROUND BEARING CAPACITY OF 1000 kPa.
9. ALL FOUNDATION EXCAVATIONS TO BE INSPECTED BY THE GEOTECHNICAL ENGINEER PRIOR TO CONCRETING.
10. REMOVAL OF FORMWORK TO BE IN ACCORDANCE WITH THE PROJECT SPECIFICATION. IT IS THE CONTRACTORS RESPONSIBILITY TO BACK-FILL/POORING ON MULTI-STORY SLAB CONSTRUCTION
11. ALL EXPOSED CORNERS TO BE CHAMFERED 25x25 O.U.

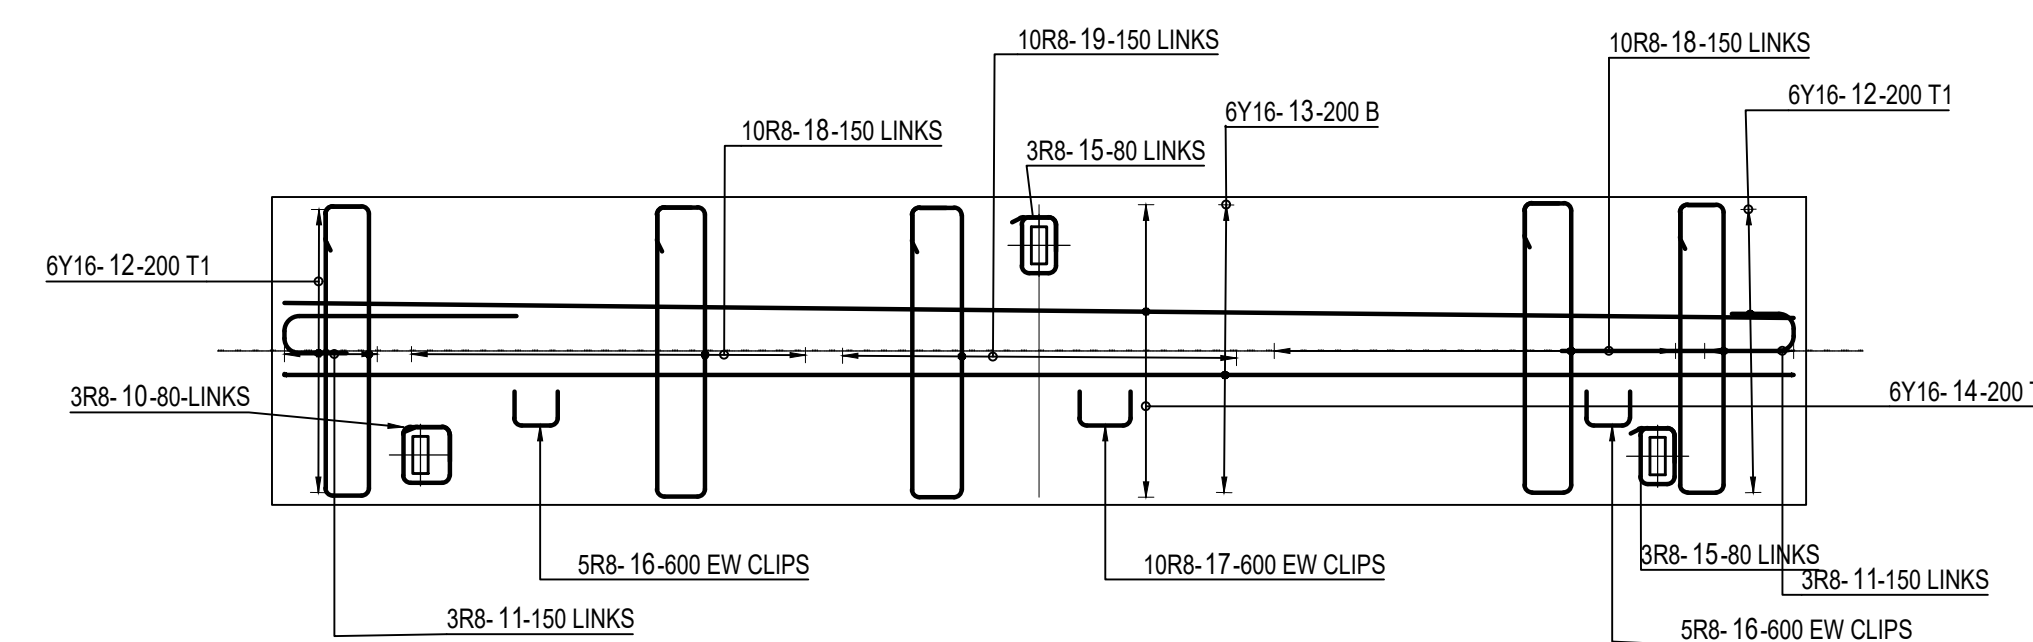

SCALE 1:25


995 PRECAST ROOF PANEL REBAR DETAIL SECTION

SCALE 1:25

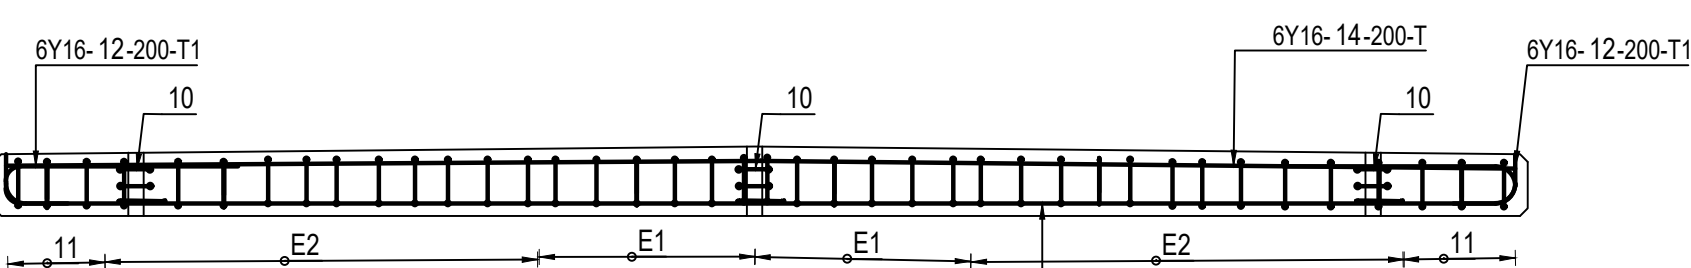


205 BRECAST ROOF PANEL BEBAP DETAIL SECTION

995 P

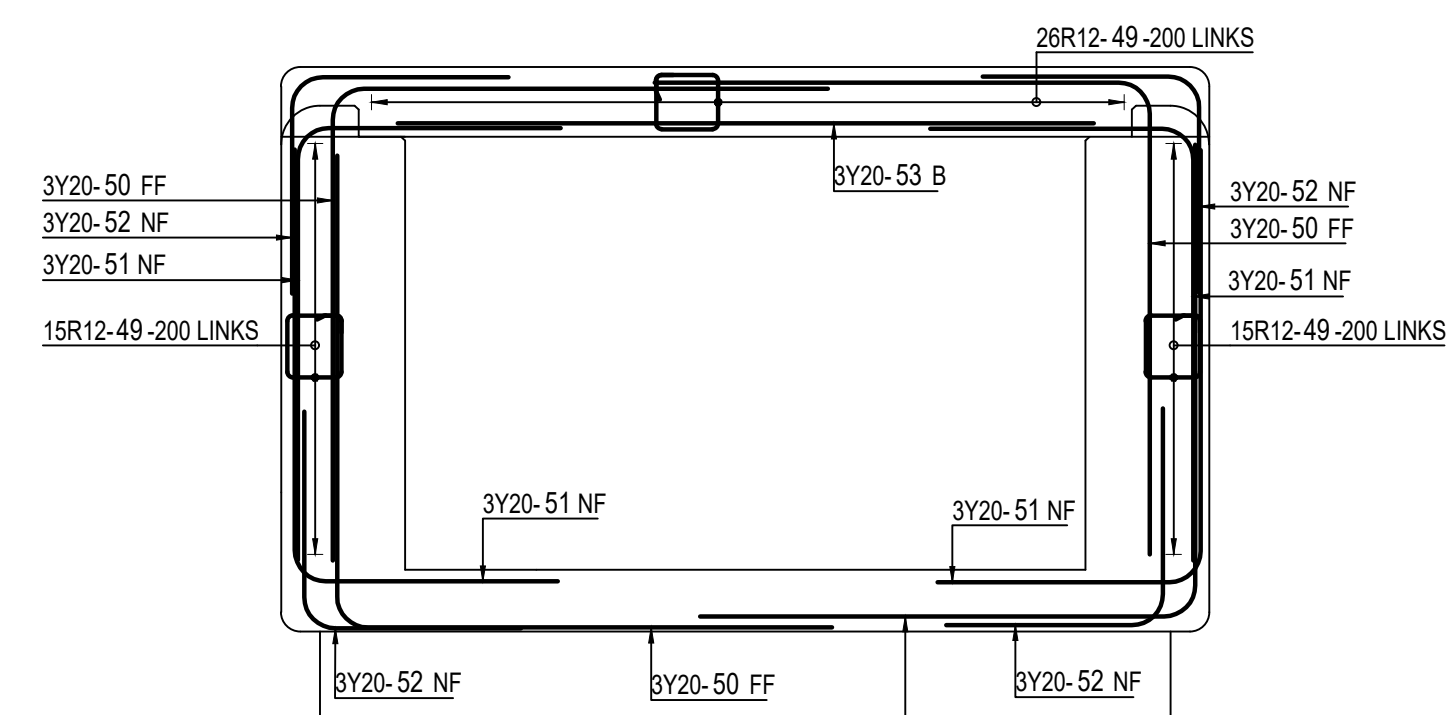

PORTAL END DETAIL

SCALE 1:50

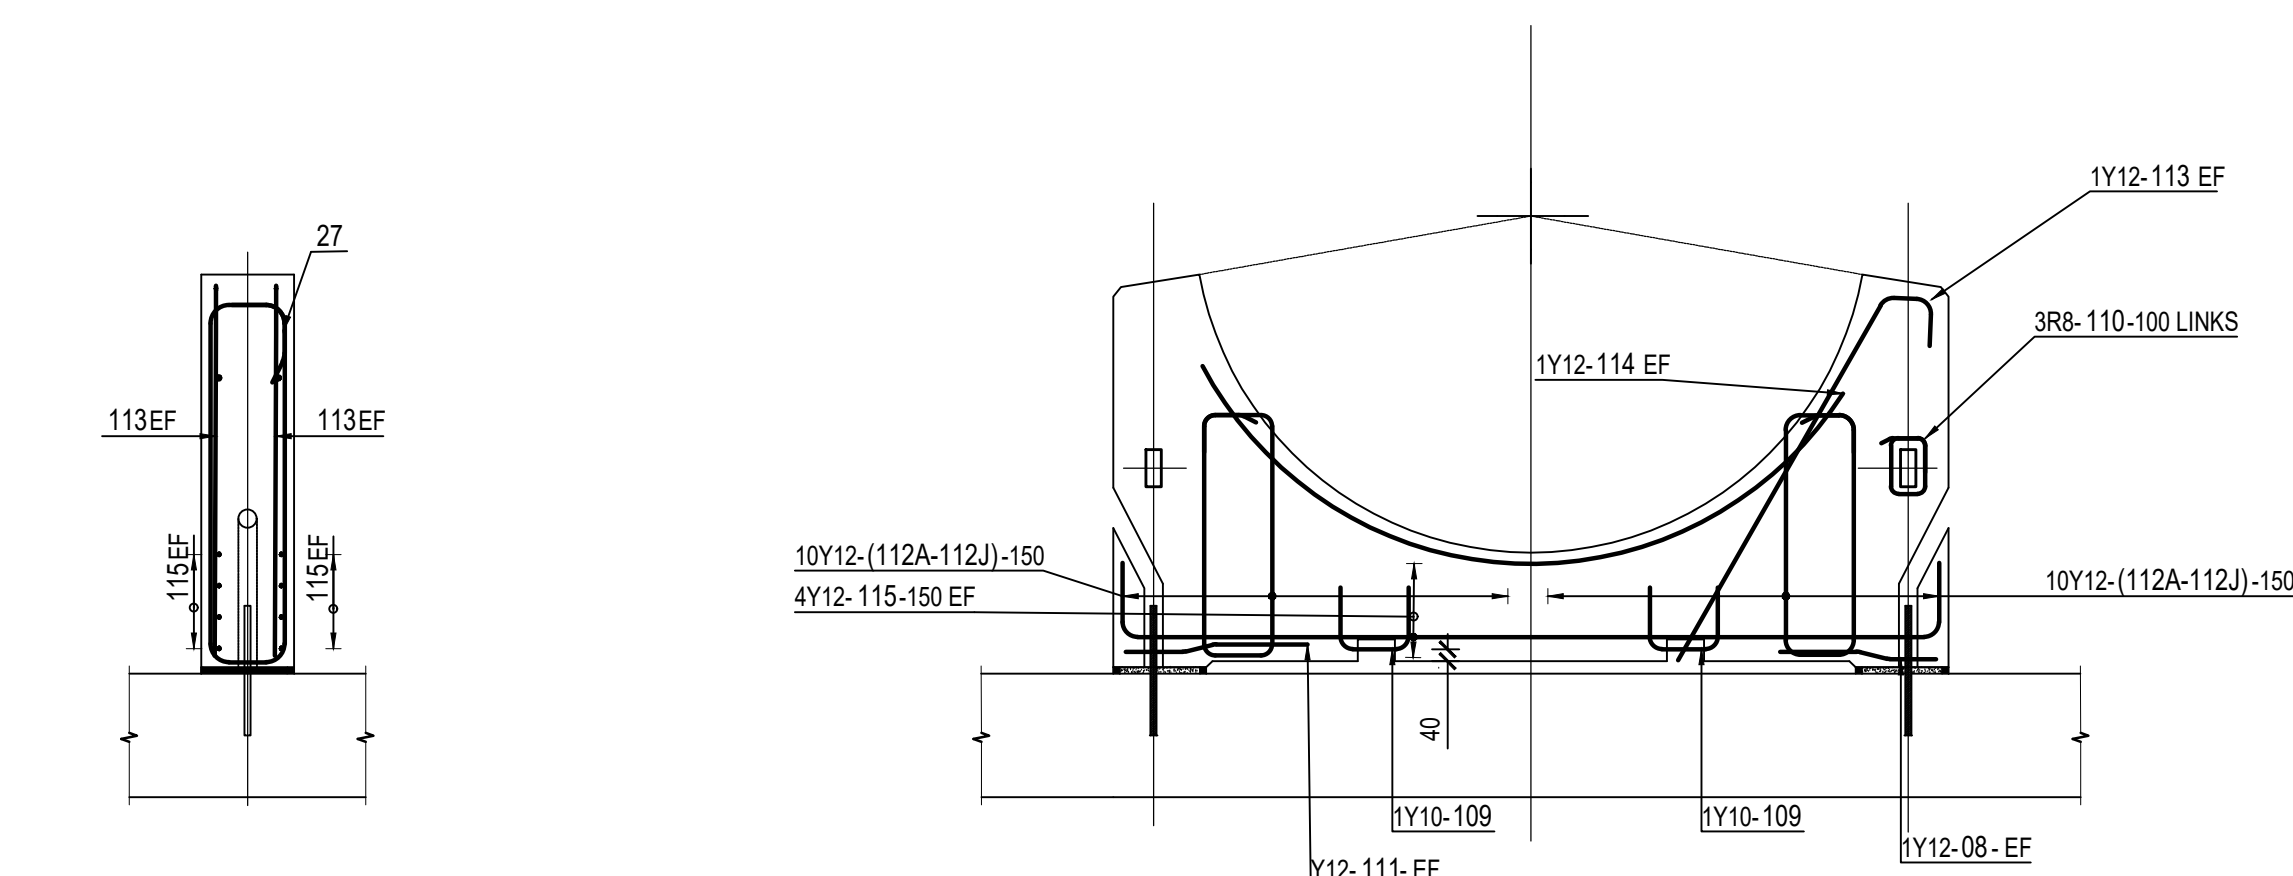

ELEVATION

SCALE 1:25

SECTION

SCALE 1:25

TYPICAL PIPE SUPPORT REBAR DETAIL

SCALE 1:25

<b>CONSULTANTS DWG NO</b>									
<b>13247-02/S/R015/A</b>									
<b>DRAWING No.</b>									

JW14455		-	A	
PROJECT No.			REV.	
A0	SHEET	3	OF	3
ORIGINAL PAGE SIZE				

FILE No.